



PLAN

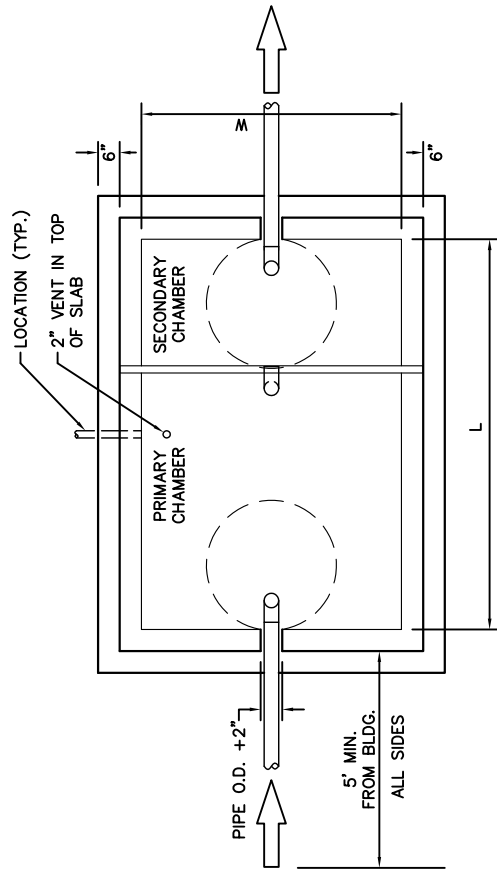

CAPACITY CHART

TOTAL WATER CAP. APPROX. (GALLONS)	GREASE CAP. APPROX. (CU. FT.)	DIMENSIONS (INCHES)									
		W	L	A	B	C	D	E			
330	13	48	72	48	24	22	24	10			
800	41	48	96	64	32	40	42	23			
1190	61	72	96	64	32	40	42	23			
1600	84	72	144	96	48	40	42	23			
1840	103	72	144	96	48	46	48	28			
2080	117	72	144	96	48	52	54	32			
2560	150	72	144	96	48	64	68	41			
3040	183	72	144	96	48	76	78	50			
3280	202	72	144	96	48	82	84	55			
3520	216	72	144	96	48	88	90	59			

TOP OF VAULT BELOW FINISHED GRADE OR AT GRADE. IF BELOW GRADE, RING AND COVER SHALL BE ADJUSTED TO FINAL GRADE USING A MINIMUM OF 4" GRADE RING(S) AND A MAXIMUM OF 36" GRADE RING(S). A CONE IS REQUIRED FOR GREATER.

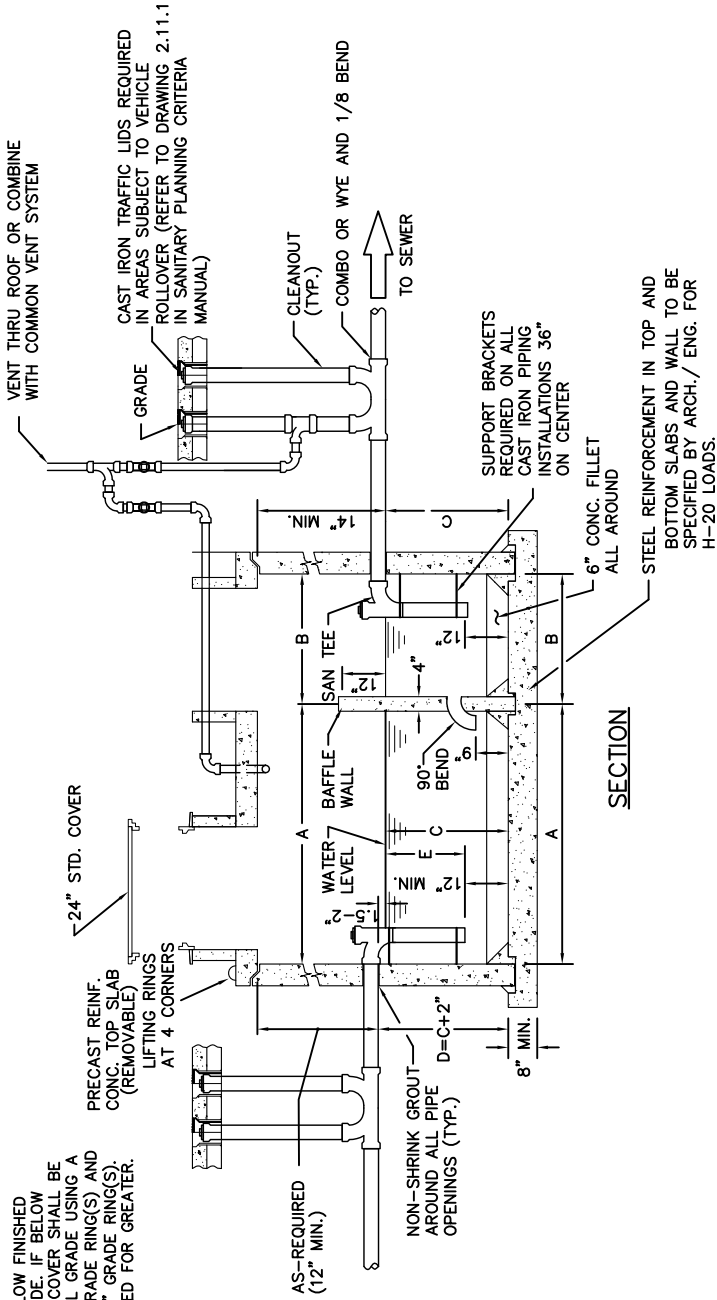

SECTION

Grease Interceptor

CITY AND COUNTY OF DENVER
DEPARTMENT OF PUBLIC WORKS
WASTEWATER MANAGEMENT DIVISION

Grease Interceptor

ISSUE DATE: JAN. 2013
DRAWN BY: DSA
CHECKED BY:

REVISED	BY	DATE